

Natural Refrigerant, Industrial High Temperature Heat Pump

Marc Portnoff
Principal Engineer
Thar Energy, LLC
Pittsburgh, PA 15238 USA

Vahid Vahdat, PhD
Senior Mechanical Design Eng.
Thar Energy, LLC
Pittsburgh, PA 15238 USA

Lalit Chordia, PhD
President, CEO
Thar Energy, LLC
Pittsburgh, PA 15238 USA

ABSTRACT

The U.S. DOE identified electrification of industrial process heat as one of the four key pathways to reduce industrial emissions. [1] Industrial thermal energy represents two-thirds of all energy demand in the industrial sector. By shifting heat production away from carbon-intensive fossil fuels to low- or zero-carbon electricity, the opportunity exists to lower costs and decarbonize the industrial sector.

Thar Energy's approach to the development of an industrial high temperature heat pump (iHTHP) system that efficiently transforms waste heat to useful process heat (e.g., air, water, steam), to temperatures up to 200°C, using electricity is discussed.

The iHTHP components, system design and operation are reviewed. The demonstration of a novel high temperature compressor (HTC) using carbon dioxide (CO₂) as a natural refrigerant, R744, is presented. Also highlighted is a CO₂-CO₂ stacked-sheet recuperator that operates at higher pressures/temperatures than commercially available heat exchangers.

INTRODUCTION

The Steam iHTHP is being designed as a drop-in replacement for gas fired steam boilers, to lower costs, minimize facility integration barriers and decarbonize industrial process heat. The opportunity is large as 60% of industrial thermal emissions are generated by process heat up to 200°C in the chemical, refining, and food industries. [2] However, to meet this market opportunity, the technical challenge is to design a reliable steam heat pump that meets economic, performance indicators and non-energy benefits required to overcome the business-as-usual culture.

Heat pumps are ubiquitous in their use, from supermarket refrigeration to residential heating and cooling. They efficiently provide heating or cooling, not by combustion of fossil fuels, but by transferring energy from one location to another. If the electricity consumed by the heat pump is renewable, the environmental impact is huge. Heat pumps are composed of four major components, a compressor, an expansion valve and two heat exchangers (HX), a condenser, and an evaporator.

Heat pump performance is measured by the coefficient of performance (COP), the ratio of the heating/cooling energy produced divided by the energy consumed. The higher the COP, the more efficient the heat pump.

The properties of the working fluid, or refrigerant, are used to determine heat pump component performance specifications and operation. That recognized early on that CO₂ is an environmentally exceptional refrigerant that: 1) is non-toxic, non-flammable, and non-corrosive; 2) is ozone layer safe; 3) has a low global warming potential of one; and 4) is low cost (up to 90% less expensive than current synthetic refrigerants). CO₂ also has refrigerant properties that allow for more efficient heat transfer and more compact heat pump components.

In the last fifteen years, environmentally friendly refrigerants, like CO₂, have moved from the research labs into the commercial marketplace, primarily in providing refrigeration for the food chain. Commercial CO₂ heat pumps, however, are limited in operating temperature range (<90°C), by design, to meet market performance/price metrics.

Compressors are the heart of the heat pump. In general, the harder a compressor works, the more electricity it consumes, and the lower the COP. Compressing a working fluid efficiently and powerfully is challenging. The efficiency of the conventional compressors, like reciprocating piston, screw, and vane compressors is limited because the mechanical methods of compressing and expanding gases suffer from a trade-off between working fluid leakage and high sealing friction [3]. Additionally, the use of lubricants and materials of construction, in state-of-the-art compressors, limit their outlet temperature to those well below proposed in this project.

RESULTS AND DISCUSSION

The iHTHP uses a novel thermodynamic cycle to produce high temperature steam up to 200°C. This cycle is enabled because the HTC can heat the CO₂ working fluid to temperatures beyond 220°C. A simple CO₂ steam heat pump process flow diagram for a recuperated cycle is shown in Figure 1.

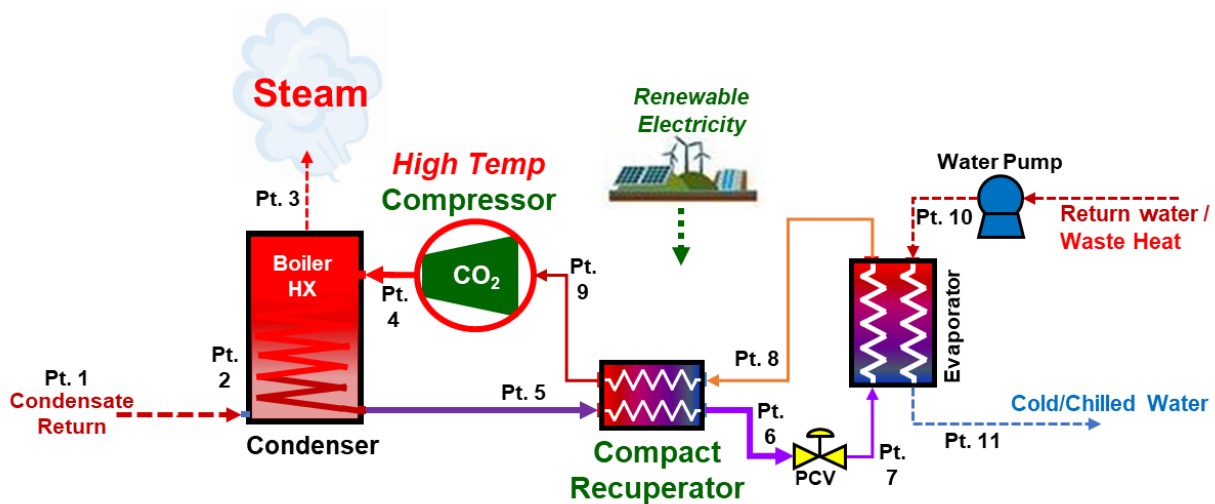


Figure 1. One-Stage sCO₂ Steam Heat Pump Process Flow Diagram

Like a natural gas boiler, make-up water or condensate return are the input to the system to produce steam, Pt 1. The condensate return enters the boiler/condenser HX, Pt 2, to be heated and vaporized to produce the process steam, Pt 3.

The energy to produce the steam in the heat pump boiler comes from the CO₂ pressurized by the HTC, Pt 4. After transferring its heat to water, CO₂ leaves the boiler and enters the recuperator HX, Pt 5. The recuperator HX, transfers thermal energy from the high temperature CO₂ leaving the boiler to the low temperature CO₂ entering the compressor at Pt 9, reducing compressor work by requiring a smaller pressure increase to reach the target temperature. The CO₂ leaving the recuperator, Pt 6, is depressurized as it passes through the expansion valve and enters the evaporator HX, Pt 7, where it is heated by the heat source fluid, water in this case, and flows to the inlet of the recuperator, Pt 8.

There are several options to heat the CO₂ entering the evaporator based on the specifics of the industrial facility. These options include using the return water, from the process cooling, prior to entering the cooling tower, or preferably from waste heat if available, Pt 10. The question of how cold the fluid stream is chilled depends on the facility. It is preferable to produce chilled water, Pt 11, as simultaneous heating and cooling improves heat pump economics.

One of the major issues with the steam HPs is the compressor's high outlet temperature that exceeds the operational specifications of the available commercial compressors. One way to reduce the required CO₂ temperature at the compressor's outlet is by using a multi-stage system. [Timothy J. Held et al., High Temperature CO₂ Heat Pumps for Industrial Process Heat Applications, The 8th International Supercritical CO₂ Power Cycles Symposium, Paper #61]. A unique 3-stage HP system was designed for this project that utilizes three compressors and three boilers, Figure 2.

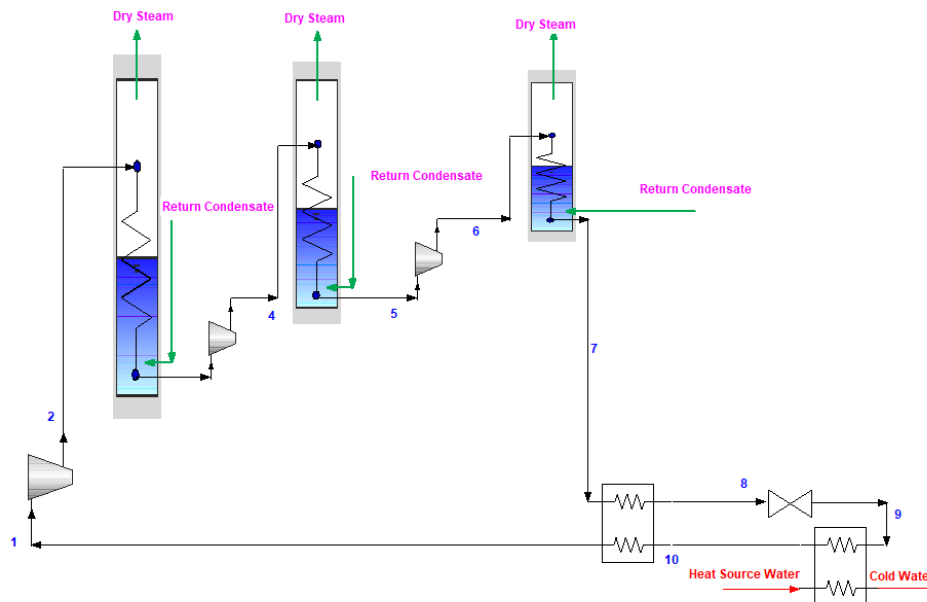


Figure 2. 3-Stage Steam Heat Pump

Two key components are highlighted in this Steam heat pump. First is the HTC, Figure 2. The HTC is a modified positive displacement pump that has been designed to compress CO₂ to

temperatures, as tested, in excess of 170°C, at differential pressures from 40 to 140 bar. The design process included evaluating variables such as the number of pistons, piston size, stroke length, RPM, and power-end operation.

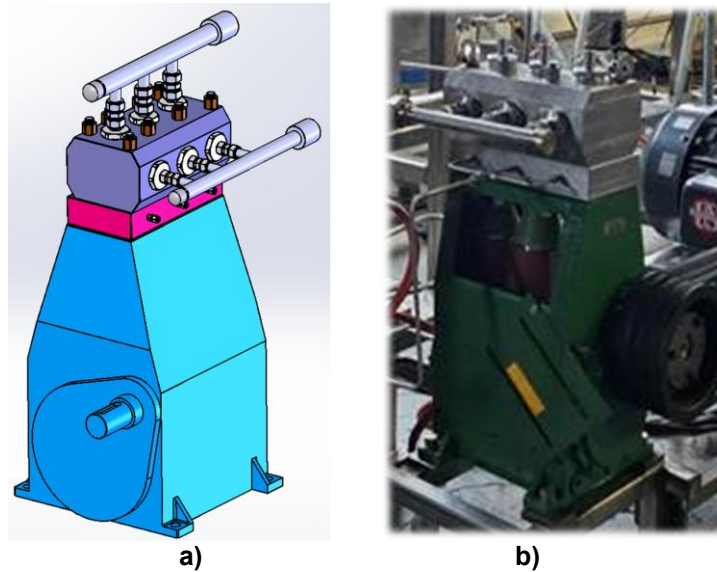


Figure 2. High Temperature Compressor, a) SolidWorks model b) As tested

The second key component is the recuperator HX. The steam heat pump operating pressures exceed the limits for commercially available braze plate heat exchangers, e.g., 150 bar.

A number of HX designs were evaluated utilizing in-house software. The stacked sheet heat exchanger (SSHX) design [4, 5] was selected based on a performance/cost analysis. The SSHX design offers high thermal and hydraulic performance in a compact and light weight recuperator with optimized material usage.

As its name implies, the SSHX core is made up of stacked perforated metal sheets, Figure 3. When sheets are stacked and aligned together, the holes form flow passages for both the high pressure, hot stream, and the low pressure, cold stream. These fluids can then transfer heat through the solid metal that separates them. If the flow passages are circular, the stacked sheets end up forming, in essence, the inner diameter of microtubes.

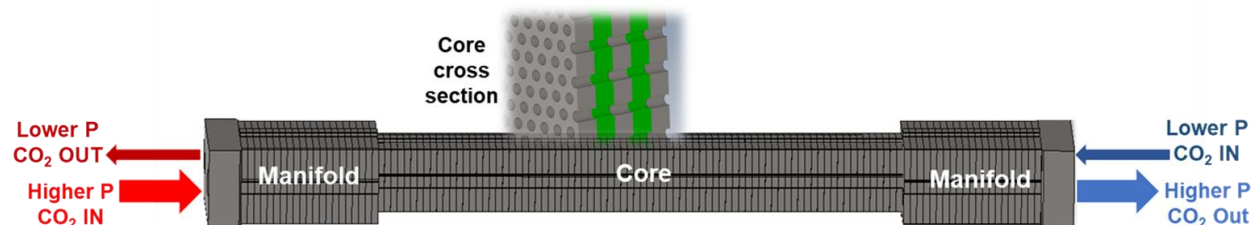


Figure 3. Steam Heat Pump sCO₂ – sCO₂ Stacked-Sheet Recuperator

Recuperator pressure drop and thermal capacity for each flow stream can be adjusted

independently by setting the number of passages, their size and spacing. Like most compact HXs, surface density and the heat transfer coefficient improve as passage size and passage spacing decrease, as does the HX size. However, manufacturing tolerances, for hole size, spacing and sheet alignment ultimately dictate how small and close the passages can be, as does corrosion, fouling allowances, and assumptions of bonding effectiveness per ASME Boiler and Pressure Vessel codes.

The sheets are permanently held together by either brazing or diffusion bonding. In addition to the HX core, manifolds are required. The manifolds are used to separate the hot and cold flows into their respective passages and to connect the separated hot and cold flows to the process piping.

One of the distinctions of the SSHX concept is that the bond between sheets is parallel to the mechanical stresses and perpendicular to the thermal gradient stresses. This improves the structural integrity and thermal compliance of the SSHX recuperator, as compared to the state-of-the-art printed circuit HX, whose bonds are oriented at 90°.

Incorporating a recuperator into the steam heat pump cycle analysis provided significant performance improvements. The addition of the recuperator reduced the flow of CO₂ by more than 50%, the compressor outlet pressure by ~45%, and improved system Coefficient of Performance (COP) by ~40%.

The Demo sCO₂ steam heat pump system was operated, successfully producing steam. The projected COP changes based on the temperature of the water entering the evaporator, heat source temperature, Figure 4. The higher the heat source temperature the higher the COP.

Next steps include evaluating and testing additional designs for improved and higher temperature HTC operations.

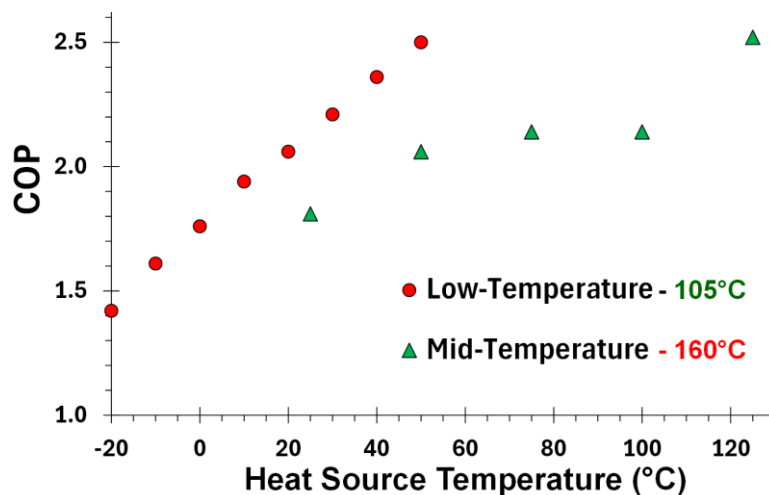


Figure 4. COP vs Heat Source Temperature Plot

REFERENCES

1. Industrial Decarbonization Roadmap, DOE/EE-2635, United States Department of Energy, September 2022
2. Thermal Process Intensification: Transforming the Way Industry Uses Thermal Process Energy, Advanced Manufacturing Office, May 2022
3. Bannwarth, H., Liquid Ring Vacuum Pumps, Compressors and Systems, Wiley-VCH Verlag GmbH & Co. KGaA, Weinheim, 2005
4. Portnoff, M., Vahdat, V., Chordia, L., Design, Fabrication and Testing of Novel Compact Recuperators for the Supercritical Carbon Dioxide Brayton Power Cycle, The 7th International Symposium-Supercritical CO₂ Power Cycles, February 23, 2022, San Antonio, TX
5. Portnoff, M., Vahdat, V., Chordia, L., Industry Panel – Status of Technology Maturation: sCO₂ Brayton Power Block Components & Cycle Development - Turning concepts into hardware, The 7th International Symposium-Supercritical CO₂ Power Cycles, February 23, 2022, San Antonio, TX

ACKNOWLEDGEMENTS

This work was supported by the U.S. Department of Energy, Energy Efficiency and Renewable Energy Industrial Technology Office, under award number DE-EE0010863